

TABLE "A" RAFTER SPANS (DOUGLAS FIR #2 OR BETTER)			TABLE "B" HEADER SIZE & SPANS (DOUGLAS FIR #2 OR BETTER)		TABLE "C" FOOTING SIZE	TABLE "D" LEDGER BOLTING
SIZE	SPACING	SPAN	RAFTER SPAN	HEADER SPAN SIZE	BASED ON 1000 P.S.F. SOIL BEARING PRESSURE.	ALL LAG BOLTS SHALL HAVE 1/4" PRE-DRILLED HOLES - (SEE NOTE 2)
2 x 4	12" O.C. 16" O.C. 24" O.C. 32" O.C.	9' - 10" 8' - 11" 7' - 8" *6' - 3"	UP TO 12'-0"	8'-0" MAX 4 x 6		
2 x 6	12" O.C. 16" O.C. 24" O.C. 32" O.C.	15' - 4" 13' - 9" 11' - 3" *9' - 7"		10'-0" MAX 4 x 8	18" SQ. X 12" DEEP	
				12'-0" MAX 4 x 10	18" SQ. X 12" DEEP	
				14'-0" MAX 4 x 12	18" SQ. X 12" DEEP	
			12'-1" TO 20'-0"	8'-0" MAX 4 x 8	24" SQ. X 12" DEEP	
2 x 8	12" O.C. 16" O.C. 24" O.C. 32" O.C.	20' - 0" 18' - 2" 14' - 10" *12' - 8"	10'-0" MAX 4 x 10	24" SQ. X 12" DEEP		
			12'-0" MAX 4 x 12	24" SQ. X 12" DEEP		
			14'-0" MAX 4 x 14	24" SQ. X 12" DEEP		
			2 x 10	12" O.C. 16" O.C. 24" O.C. 32" O.C.	20' - 0" 20' - 0" 18' - 11" *16' - 2"	8'-0" MAX 4 x 8
4 x 4	24" O.C. 32" O.C. 48" O.C.	10' - 0" *9' - 3" *7' - 8"	10'-0" MAX 4 x 10	24" SQ. X 12" DEEP		
			12'-0" MAX 4 x 12	24" SQ. X 12" DEEP		
			14'-0" MAX 4 x 14	24" SQ. X 12" DEEP		
4 x 6	24" O.C. 32" O.C. 48" O.C.	15' - 11" *13' - 9" *11' - 3"	12'-0" MAX 4 x 12	24" SQ. X 12" DEEP		
			14'-0" MAX 4 x 14	24" SQ. X 12" DEEP		
			4 x 8	24" O.C. 32" O.C. 48" O.C.	20' - 0" *18' - 2" *14' - 10"	8'-0" MAX 4 x 8

NOTES:

- TWO 2X MEMBERS MAY BE SUBSTITUTED FOR ONE 4X HORIZONTAL FRAMING MEMBER.
- LAG BOLTS MUST FULLY ENGAGE A WOOD STUD OR RIM JOIST AND BE PROVIDED WITH APPROPRIATE WASHERS. LAG BOLTS SHALL BE LOCATED A MINIMUM OF 1-1/2" FROM THE TOP OR BOTTOM OF THE LEDGER.
- NOT DESIGNED TO BE ENCLOSED - ADDITIONAL ENGINEERING ANALYSIS WILL BE REQUIRED IF ENCLOSED.
- SEE PAGE 2 OF 2 FOR CONSTRUCTION DETAILS.

DISCLAIMER:


ALTERNATE PATIO DESIGNS MAY BE POSSIBLE WHEN PROVIDED WITH AN ENGINEERED ANALYSIS. USE OF THIS CONVENTIONAL STANDARD DESIGN IS AT THE USER'S RISK AND CARRIES NO IMPLIED OR INFERRED GUARANTEE AGAINST FAILURE OR DEFECTS.

* THIS SPACING AND SPAN IS FOR LATTICE PATIO COVERINGS ONLY.


WESTERN RIVERSIDE COUNTY CODE UNIFORMITY PROGRAM			
	CITY OF MENIFEE		
	BUILDING DEPARTMENT		
PATIO COVER STANDARD			
(951)672-6777		29714 HAUN ROAD, MENIFEE, CA 92586	
FAX (951) 679-3843		2/24/2014	WWW.CITYOFMENIFEE.US
		PAGE 1 OF 2	

KNEE BRACE DETAIL AT END POSTS

(REQUIRED WHEN RAFTER SPAN EXCEEDS 12 FT.)

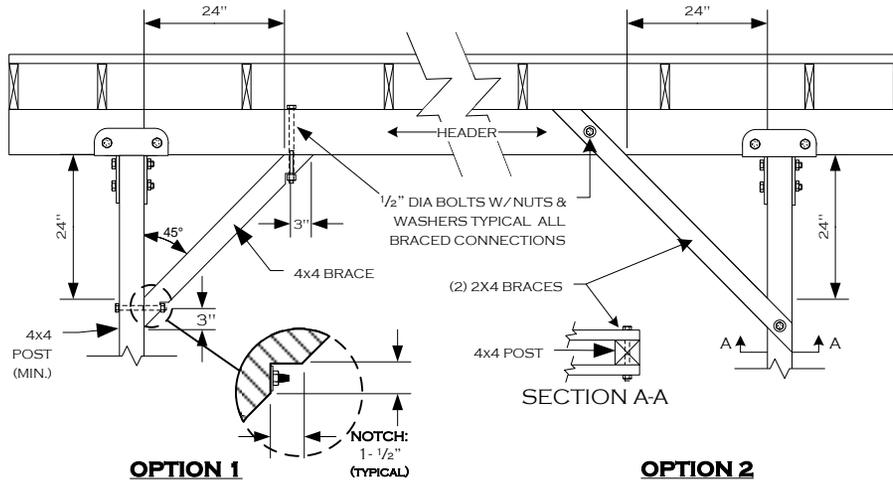


LEDGER ATTACHMENT DETAIL

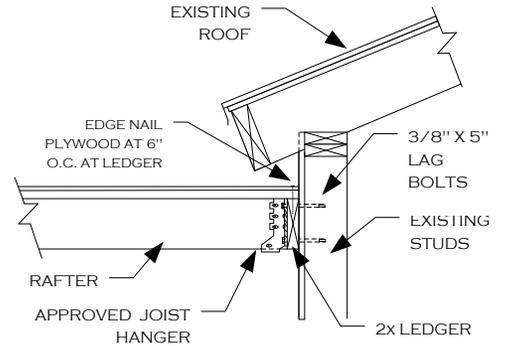

NOTES:

1. USE A CONTINUOUS 2X LEDGER – SAME DEPTH AS RAFTER OR LARGER
2. SEE TABLE "D" FOR BOLTING REQUIREMENTS

INVERTED HEADER DESIGN OPTION (LATTICE ONLY)

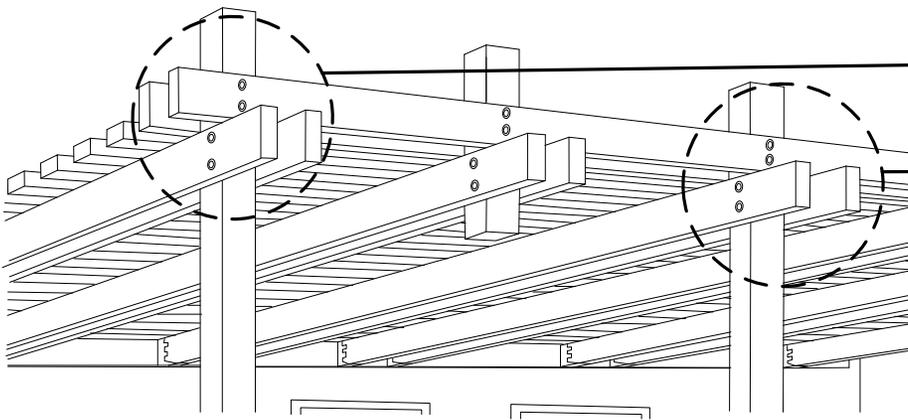

TWO 1/2" DIA. THRU-BOLTS (W/ WASHERS), PER CONNECTION AS SHOWN



FOR HEADERS OR RAFTERS—TWO 2X MEMBERS MAY BE SUBSTITUTED FOR ONE 4X MEMBER. SEE TABLES "A" & "B" FOR SPAN LIMITS

NOTE: KNEE BRACING REQUIRED WHEN RAFTER SPAN EXCEEDS 12 FEET

2X FASCIA (OVERHANG) ATTACHMENT – LATTICE ONLY

OPTION 1

OPTION 2

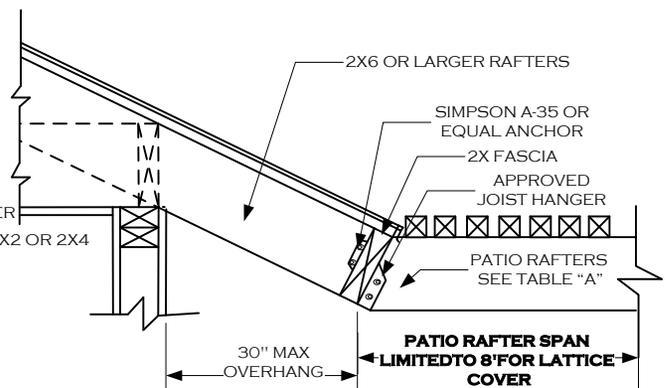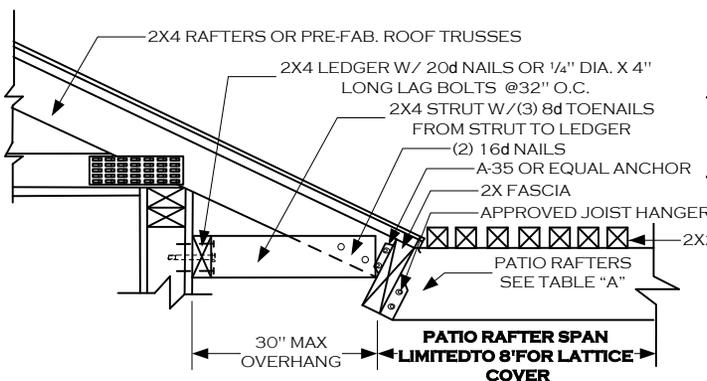

NOTE: VERIFY STRUCTURAL SOUNDNESS OF ROOF RAFTERS FOR DECAY OR TERMITE DAMAGE, AND REPLACE WITH LIKE MATERIALS AS NEEDED, AFTER CONSULTATION WITH THE BUILDING DEPARTMENT.

WESTERN RIVERSIDE COUNTY CODE UNIFORMITY PROGRAM



CITY OF MENIFEE BUILDING DEPARTMENT

PATIO COVER STANDARD

(951) 672-6777

29714 HAUN ROAD, MENIFEE, CA 92586

FAX (951) 679-3843

2/24/2014

WWW.CITYOFMENIFEE.US

PAGE 2 OF 2