


FRONT VIEW

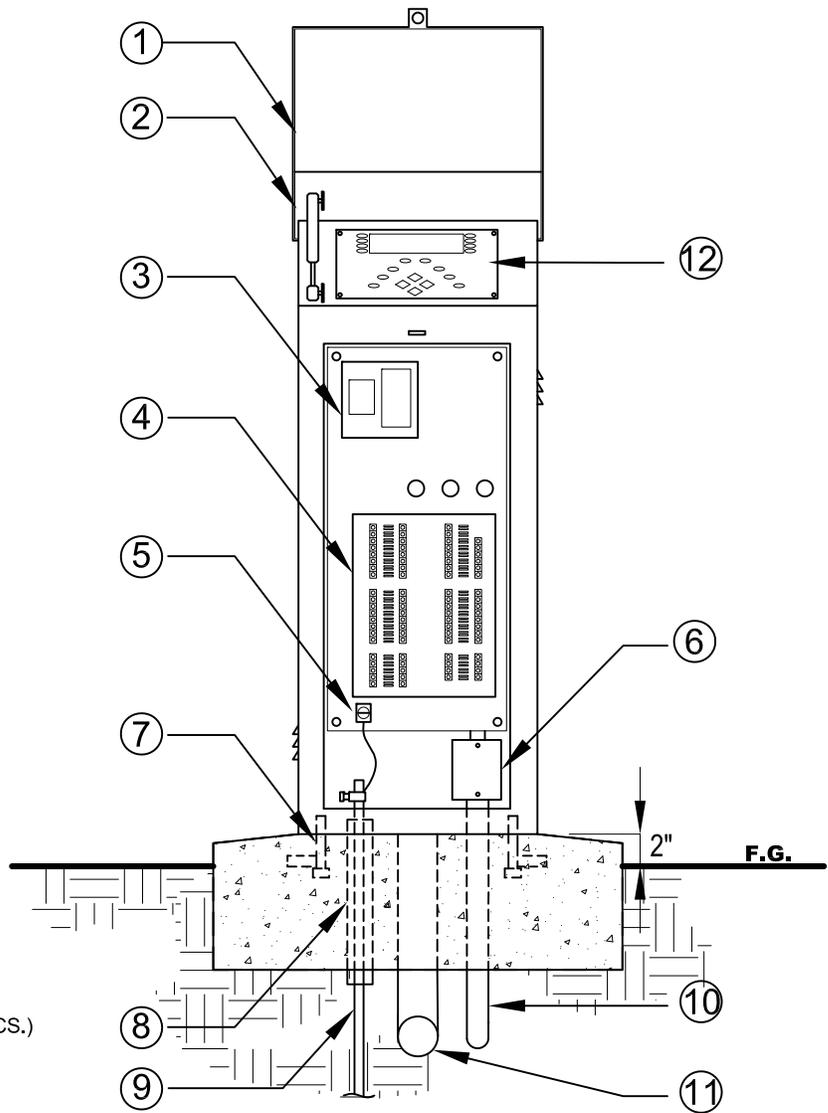

1. CONTROLLER WITH STAINLESS STEEL ENCLOSURE AND DOME ANTENNA (SEE SPECS.)
2. FLIP TOP IN OPEN POSITION
3. GFCI OUTLET & SWITCH
4. TRANSIENT PROTECTION BOARD
5. GROUNDING WIRE (#6 / SOLID COPPER) CONNECTED TO GROUND LUG
6. 120 VAC JUNCTION BOX
7. MOUNTING BOLTS AS REQUIRED
8. 3/4-INCH GROUNDING ROD SLEEVE - PVC SCHEDULE 40
9. GROUNDING ROD - 5/8-INCH X 8 FEET COPPER
10. CONDUIT FOR 120 VAC POWER
11. CONDUITS FOR MASTER CONTROL VALVE, FLOW SENSOR, AND SPARE (EMPTY) / FUTURE
12. CONTROLLER PANEL MOUNTED FLUSH ON FACE OF ENCLOSURE

**SECTION
NO SCALE**

NOTE:

- A. CONTRACTOR SHALL ADJUST ALL IRRIGATION TO PREVENT OVER SPRAY ON CONTROLLER ENCLOSURE.
- B. CONTROLLER COMPONENTS SHALL BE CERTIFIED BY CALSENSE.
- C. CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION AND INSTALLATION OF REQUIRED CONTROLLER COMMUNICATIONS. CONTACT CALSENSE FOR PROJECT REQUIREMENTS.

APPROVED BY:

Jonathan D. Li

4/24/15

DIRECTOR OF PUBLIC WORKS
JONATHAN GEORGE SMITH

DATE



CITY OF MENIFEE

**CONTROLLER
(IN STAINLESS STEEL
ENCLOSURE)**

REVISION	BY:	APPROVED	DATE