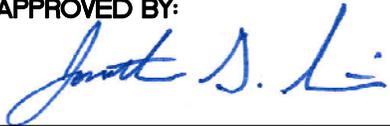


- 1. MAINLINE TEE PER SPECS.
- 2. CONCRETE THRUST BLOCK TYP.
- 3. COMPACTED BACKFILL TYP.
- 4. MAINLINE ELL 45° PER SPECS.
- 5. MAINLINE PER SPECS. TYP.
- 6. MAINLINE ELL 90° PER SPECS.
- 7. UNDISTURBED NATIVE SOIL TYP.

- NOTES:
- A. SUPPLY LINES 2.5-INCH TO 3-INCH IN DIAMETER SHALL RECEIVE CONCRETE THRUST BLOCKS
 - B. SUPPLY LINES OVER 3 INCHES SHALL HAVE IRON DUCTILE RESTRAINT SYSTEM.
 - C. A MINIMUM OF 6 INCHES OF CONCRETE SHALL BE POURED ON UNDISTURBED OR COMPACTED SOIL.
 - D. WHERE CONCRETE AND PVC ARE IN CONTACT, PVC PIPE SHALL BE PROTECTED WITH PIPE WRAP.

**PLAN
NO SCALE**

APPROVED BY:

 4/24/15
 DIRECTOR OF PUBLIC WORKS DATE
 JONATHAN GEORGE SMITH

REVISION	BY:	APPROVED	DATE



CITY OF MENIFEE

**THRUST BLOCK
3" MAIN & SMALLER**

STANDARD PLAN NO. 1302.15 SHEET 1 OF 1