


TOP OF SLOPE OR WALL

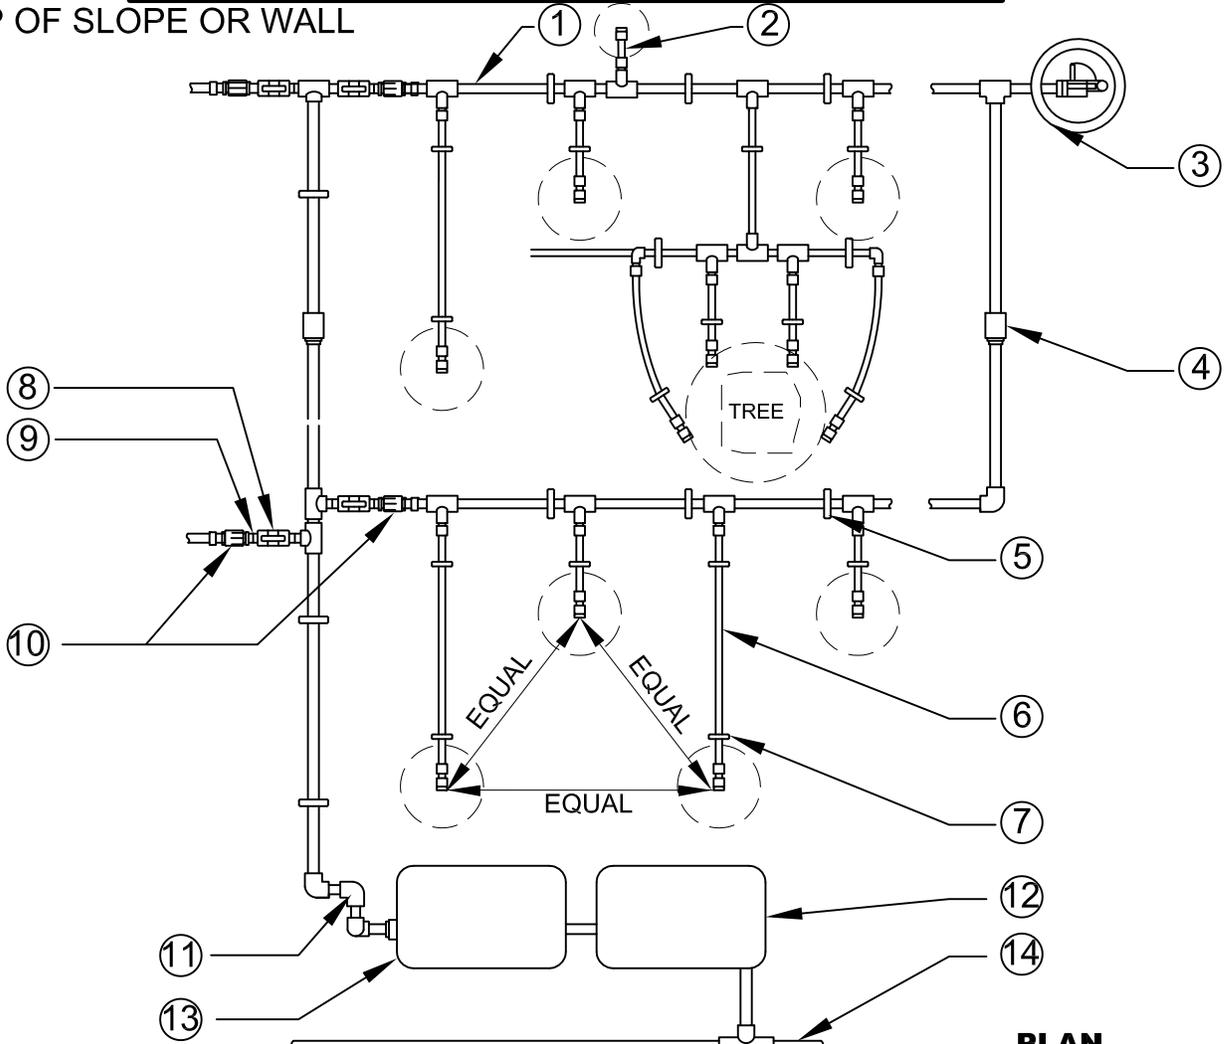

SIDEWALK OR CURB

**PLAN
NO SCALE**

1. PIPING ELEVATION SHALL NOT EXCEED 18 INCHES OF ELEVATION CHANGE
2. VINE EMITTER @ 10' O.C. SPACING, OR PER PLAN
3. FLUSH VALVE END CAP - 200 FEET MAX PER DETAIL
4. SWING CHECK VALVE BELOW EACH HORIZ. LINE
5. EPOXY COATED J-HOOKS PER SPECS.
6. EMITTER ASSEMBLY PER DETAIL 1302.28
7. 9-INCH PVC COATED GALV. STAPLE
8. SCHEDULE 80 BALL VALVE TYP. - LINE SIZE
9. SCHEDULE 80 NIPPLE TYP.
10. PRESSURE REGULATOR PER DETAIL 1302.26
11. UVR ELLS FOR SLOPE GRADE TRANSITION WHEN APPLICABLE
12. REMOTE CONTROL VALVE PER DETAIL 1302.07 / 12 INCHES FROM SIDEWALK
13. FILTER
14. MAINLINE PER SPECS.

NOTES:

- A. ALL PIPING FOR POINT TO POINT LATERALS SHALL BE BURIED 4 INCHES DEEP. PIPING SHALL BE UVR PVC AND HAVE J-HOOKS PER DETAILS AND SPECS.
- B. ALL UVR PIPE JOINTS AND FITTINGS BELOW GRADE AND ABOVE GRADE SHALL BE PRIMED.

APPROVED BY:

Jonathan S. Li

4/24/15

DIRECTOR OF PUBLIC WORKS
JONATHAN GEORGE SMITH

DATE



CITY OF MENIFEE

**POINT TO POINT
IRRIGATION
BELOW GRADE LATERALS**

REVISION	BY:	APPROVED	DATE
1	G.H.	J.S.	1/15/16

STANDARD PLAN NO. 1302.27 SHEET 1 OF 1