


**SUMP OPTION**

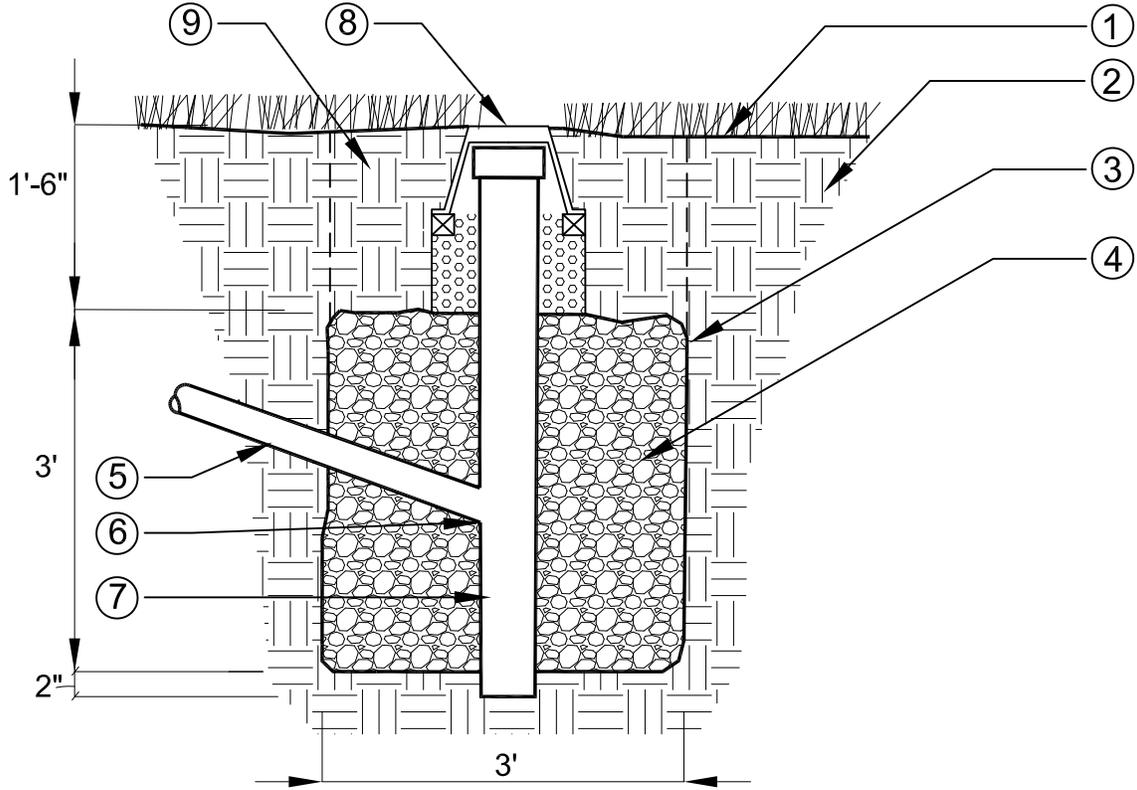

1. FINISH GRADE (18 INCHES HEIGHT ABOVE SUMP)
2. UNDISTURBED NATIVE SOIL
3. INSTALL FILTER FABRIC AT PERIMETER OF SUMP PER SPECIFICATIONS
4. SUMP WITH 3/4-INCH CRUSHED ROCK
5. DRAIN LINE (TYP.) - SIZE PER PLAN
6. INVERT ELEVATION (MAINTAIN 2% SLOPE (MIN.) FROM DRINKING FOUNTAIN)
7. 6-INCH PERFORATED DRAINLINE (TYP.)
8. 8-INCH ROUND VALVE BOX AT FINISH GRADE - PLACE ON 3 BRICK SUPPORTS
9. COMPACT SOIL ABOVE SUMP TO DENSITY OF ADJACENT UNDISTURBED SOIL

**SECTION  
NO SCALE**

APPROVED BY:

*Jonathan George Smith*

1/15/16

DIRECTOR OF PUBLIC WORKS  
JONATHAN GEORGE SMITH

DATE



**CITY OF MENIFEE**

**DRINKING FOUNTAIN  
DRAINAGE**

REVISION	BY:	APPROVED	DATE

STANDARD PLAN NO. 1301.18 | SHEET 1 OF 1