


**SECTION  
NO SCALE**

1. FINISH GRADE IN PLANTER - 4 INCHES BELOW BOX
2. UVR/PVC LATERAL LINE - DEPTH PER SPECS.
3. STD. RECTANGLE VALVE BOX WITH LOCKING SS BOLT (HEAT BRAND "F" FOR FILTER)
4. PVC SCH 80 UNION
5. 1/2-INCH GALV. WIRE MESH BELOW BOX
6. PVC SCH 80 NIPPLE 24-INCH MIN. LENGTH
7. PVC SCH 80 FEMALE COUPLING
8. BASKET FILTER (VALVE SIZE) USE 2 FILTERS FOR FLOWS OVER 20.0 GPM / PROVIDE 75/100 MESH SCREEN
9. PVC SWING CHECK VALVE (AS REQUIRED)

**NOTES:**

A. REFER TO DETAIL 1302.07 FOR ALL RCV REQUIREMENTS.

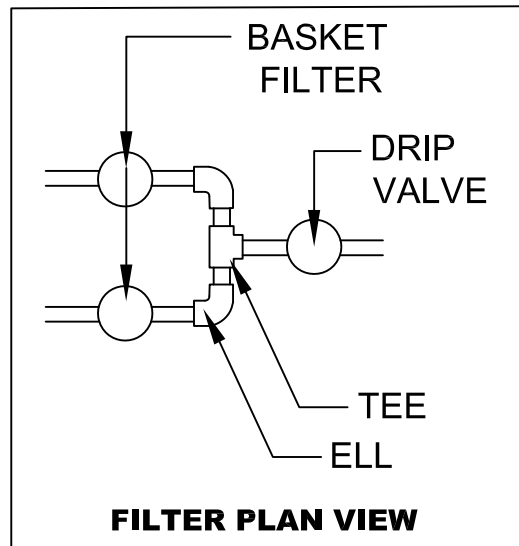

**FILTER PLAN VIEW**

**APPROVED BY:**

*Jonathan G. Smith*  
 DIRECTOR OF PUBLIC WORKS  
 JONATHAN GEORGE SMITH

1/15/16  
 DATE



**CITY OF MENIFEE**

**IRRIGATION FILTER**

REVISION	BY:	APPROVED	DATE